


PERMANENT CHANGES TO PLUMBING REQUIRES A PLUMBING PERMIT

ABS DISCHARGE MAY NOT BE DIRECTED ONTO A PERVIOUS GROUND SURFACE WITHIN 1.8M OF ANY BUILDING

**CONCEPTUAL DRAWING
SANITARY SERVICE LINE MAY VARY IN EACH HOME

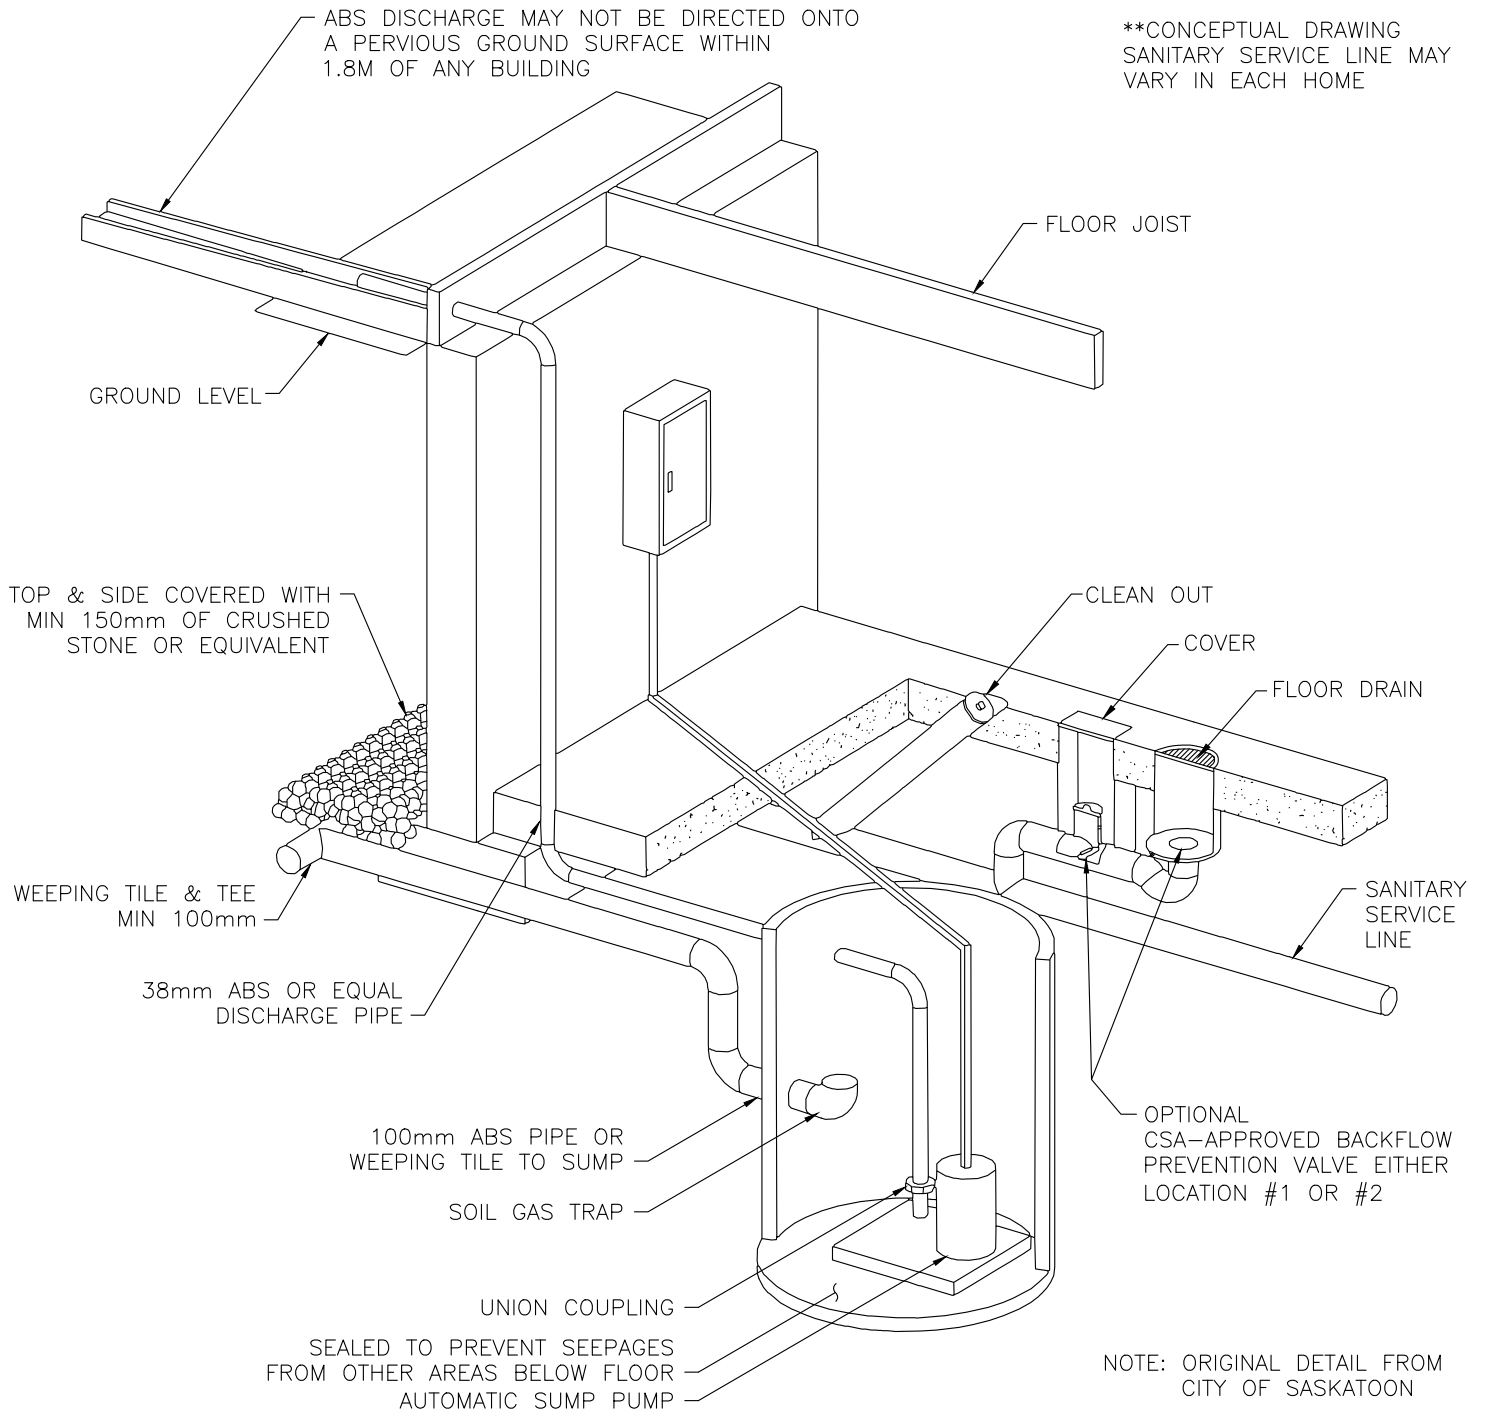

- ENSURE THAT THE SUMP IS A MINIMUM 1m FROM THE FOOTINGS.
- PROVISIONS REQUIRED TO PREVENT SOIL GAS FROM ENTERING THE DWELLING FROM THE SUMP AND WEEPING TILE.

CODE REFERENCE ON SUMP:
NATIONAL BUILDING CODE SECTION 9.14.2
FOUNDATION DRAINAGE
9.14.5.2 SUMP PITS

SUMP PIT MAY BE CONSTRUCTED OF:

- A) CONCRETE
- B) CORROSION RESISTANT STEEL
- C) PLASTIC

WHERE A SUMP PIT IS PROVIDED IT SHALL BE:

- A) NOT LESS THAN 600mm DEEP
- B) NOT LESS THAN 0.25sq.m IN AREA, AND
- C) PROVIDED WITH A COVER

NOTE: ORIGINAL DETAIL FROM CITY OF SASKATOON

			CITY OF PRINCE ALBERT PUBLIC WORKS		APPROVED <i>Wes Hicks</i>
			TYPICAL WEEPING TILE CONNECTION		SCALE N.T.S.
1	JAN 2017	REVISED TO ADD TYPICAL SUMP			DWG. No. 00-01-11
No.	DATE	REVISION	DRAWN S. NUMEDAHL	DESIGNED N. MILLER	DATE OCT. 2014