


UTILITY CUT WITHIN 600mm OF SIDEWALK/STRUCTURE

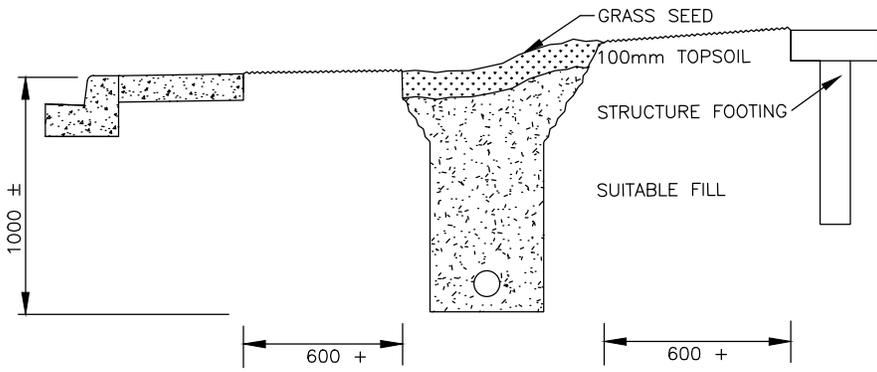

UTILITY CUT ≥ 600mm FROM SIDEWALK/STRUCTURE

GENERAL NOTES

- ALL BURIED UTILITY CUTS AND RESTORATIONS MUST BE REPORTED TO PUBLIC WORKS AND FOLLOW PROCEDURES AS PER MASTER SPECIFICATIONS 6100: SHALLOW BURIED UTILITIES.
- ALL DIMENSIONS ARE IN MM.
RELATED SECTIONS: GRANULAR BASE 02721 |
- TOPSOIL 02212 | SEEDING 02933
- CONTACT COMMUNITY SERVICES AT 306-953-4800 TO PURCHASE GRASS SEED MIX.
- FOR AREAS WITH IRRIGATION, USE GRASS SEED MIX:
40% CREEPING RED FESCUE "BOREAL"
37% PERENNIAL RYE "FIESTA 3"
15% KENTUCKY BLUE "ABLE 1"
8% KENTUCKY BLUE "MIDNIGHT"
- FOR AREAS WITH NO IRRIGATION, USE GRASS SEED MIX:
35% ABERDEEN CREEPING RED FESCUE
25% SHADOW III CHEWINGS FESCUE
20% SHEEP FESCUE
20% HARD FESCUE

SUMMER WORK CONDITIONS

RESTORATION PROCEDURE

- ALL EXCAVATED MATERIAL WILL BE HAULED AND DISPOSED BY THE COMPANY.
- IF THE CUT IS WITHIN 600MM OF A SIDEWALK OR A STRUCTURE, GRANULAR BASE COURSE WILL BE PLACED IN 150MM LIFTS (MAXIMUM), COMPACTED TO 95% OF STANDARD PROCTOR DENSITY OR 0.6 MPA NON-SHRINK FILL WILL BE USED TO A DEPTH OF 100MM BELOW EXISTING TOPSOIL.
- IF THE CUT IS FURTHER THAN 600MM OF A SIDEWALK OR A STRUCTURE, SUITABLE FILL WILL BE PLACED IN 150MM LIFTS (MAXIMUM), COMPACTED TO 95% OF STANDARD PROCTOR DENSITY TO A DEPTH OF 100MM BELOW EXISTING TOPSOIL.
- MINIMUM 100MM OF TOPSOIL WILL BE PLACED AND RAKED-IN PROVIDING A SMOOTH TRANSITION TO THE NEIGHBORING SOILS.
- GRASS SEED WILL BE BROADCAST IN PLACE AT 220 KG/HA (22G/M²) AND RAKED-IN THE TOP 5MM SURFACE OF THE TOPSOIL. GRASS SEED MIX WILL BE USED AS BELOW.

WINTER WORK CONDITIONS

RESTORATION PROCEDURE

- ALL SNOW, ICE AND EXCAVATED MATERIAL IS TO BE HAULED TO AN APPROVED DISPOSAL AREA OFF SITE
- IF THE CUT IS WITHIN 600MM OF A SIDEWALK OR A STRUCTURE, GRANULAR BASE COURSE WILL BE PLACED IN 150MM LIFTS (MAXIMUM), COMPACTED TO 95% OF STANDARD PROCTOR DENSITY TO TOP OF TOPSOIL.
- IF THE CUT IS FURTHER THAN 600MM OF A SIDEWALK OR A STRUCTURE, SUITABLE FILL WILL BE PLACED IN 150MM LIFTS (MAXIMUM), COMPACTED TO 95% OF STANDARD PROCTOR DENSITY TO TOP OF TOPSOIL.
- IN SUMMER CONDITIONS, THE COMPANY WILL REMOVE THE GRANULAR BASE COURSE OR FILL TO 100MM BELOW TOPSOIL.
- A MINIMUM 100MM OF TOPSOIL WILL BE PLACED AND RAKED-IN PROVIDING A SMOOTH TRANSITION TO THE NEIGHBORING SOILS.
- GRASS SEED WILL BE BROADCAST IN PLACE AT 220 KG/HA (22G/M²) AND RAKED-IN THE TOP 5MM SURFACE OF THE TOPSOIL. GRASS SEED MIX WILL BE USED AS BELOW.

			CITY OF PRINCE ALBERT PUBLIC WORKS			APPROVED <i>Wes Hicks</i>			
			SHALLOW BURIED UTILITY REPAIR TYPICAL BOULEVARD AND PARK CUT					SCALE N.T.S.	
2	FEB 2020	REVISED SPECIFICATIONS	DRAWN R.REGNIER			DESIGNED M.GAREAU		DATE FEB 2020	
1	NOV 2018	REVISED SPECIFICATIONS							
No.	DATE	REVISION	DRAWN R.REGNIER		DESIGNED M.GAREAU		DATE FEB 2020		DWG. No. 00-04-21