


SUMMER/WINTER WORK CONDITIONS

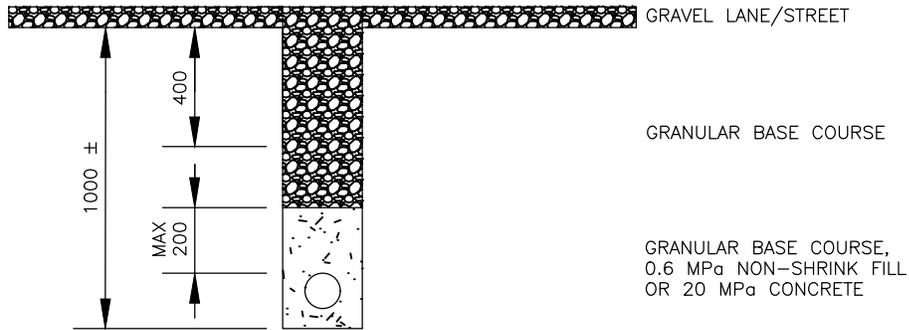

SUMMER RESTORATION PROCEDURE

1. ALL PAVEMENT EDGES ARE TO BE SAW CUT.
2. ALL EXCAVATED MATERIAL WILL BE HAULED AND DISPOSED BY THE COMPANY.
3. THE COMPANY MAY PLACE GRANULAR BASE COURSE OR 0.6 MPA NON-SHRINK FILL OR 20 MPA CONCRETE AROUND THE UTILITY TO A MAXIMUM OF 200 MM ABOVE THE UTILITY.
4. GRANULAR BASE COURSE WILL BE PLACED UP TO TOP OF ROAD SURFACE. A PLATE TAMPER OR VIBRATORY ROLLER MUST BE USED FOR COMPACTION OF GRAVEL. BASE GRAVEL SHALL BE PLACED IN 150MM LIFTS (MAXIMUM) AND COMPACTED TO 100% OF STANDARD PROCTOR DENSITY.
5. ASPHALT PATCH MUST BE THE GREATER OF 80MM THICK OR THE EXISTING ASPHALT THICKNESS.
6. MAXIMUM LIFT THICKNESS IS 80MM.

WINTER RESTORATION PROCEDURE

1. ALL SNOW, ICE AND EXCAVATED MATERIAL IS TO BE HAULED TO AN APPROVED DISPOSAL AREA OFF SITE
2. THE COMPANY MAY PLACE GRANULAR BASE COURSE OR 0.6 MPA NON-SHRINK FILL OR 20 MPA CONCRETE AROUND THE UTILITY TO A MAXIMUM OF 200 MM ABOVE THE UTILITY.
3. GRANULAR BASE COURSE TO BE PLACED UP TO THE TOP OF THE ROAD SURFACE. A PLATE TAMPER OR VIBRATORY ROLLER MUST BE USED FOR COMPACTION OF GRAVEL. BASE GRAVEL SHALL BE PLACED IN 150MM LIFTS (MAXIMUM) WITH A COMPACTIVE EFFORT MADE.
4. THE COMPANY IS RESPONSIBLE FOR MAINTAINING THE REPAIR UNTIL IT CAN BE INSPECTED IN SUMMER CONDITIONS AND ANY DEFICIENCIES CORRECTED BY THE COMPANY.
5. IF THE REPAIR HAS SETTLED, OR THE GRANULAR BASE COURSE IS SATURATED OR SOFT, THE REPAIR WILL BE EXCAVATED TO A DEPTH OF 400 MM. EXCAVATED MATERIAL CAN BE SPREAD ALONG THE EDGE OF THE GRAVEL ROAD UNIFORMLY.
6. GRANULAR BASE COURSE WILL BE REPLACED UP TO THE TOP OF THE ROAD SURFACE. A PLATE TAMPER OR VIBRATORY ROLLER MUST BE USED FOR COMPACTION OF GRAVEL. BASE GRAVEL SHALL BE PLACED IN 150MM LIFTS (MAXIMUM) AND COMPACTED TO 100% OF STANDARD PROCTOR DENSITY.

GENERAL NOTES

1. ALL BURIED UTILITY CUTS AND RESTORATIONS MUST BE REPORTED TO PUBLIC WORKS AND FOLLOW PROCEDURES AS PER MASTER SPECIFICATIONS 6100: SHALLOW BURIED UTILITIES.
2. ALL DIMENSIONS ARE IN MM.
3. RELATED SECTIONS: GRANULAR BASE 02721

			CITY OF PRINCE ALBERT PUBLIC WORKS			APPROVED <i>Wes Hicks</i>
			SHALLOW BURIED UTILITY REPAIR TYPICAL GRAVEL LANE & STREET CUT			SCALE N.T.S.
2	FEB 2020	REVISED SPECIFICATIONS				DWG. No. 00-04-18
1	NOV 2018	REVISED SPECIFICATIONS				
No.	DATE	REVISION	DRAWN R.REGNIER	DESIGNED M.GAREAU	DATE FEB 2020	